



# TRH200

## RELATIVE HUMIDITY MEASUREMENT SENSOR



### User manual

22/10 - Code: ISTR\_M\_TRH200\_E\_01\_--

#### ASCON TECNOLOGIC S.r.l.


Viale Indipendenza 56, 27029 - VIGEVANO (PV) ITALY

TEL.: +39 0381 69871 - FAX: +39 0381 698730

sito: <http://www.ascontecnologic.com>

e-mail: [info@ascontecnologic.com](mailto:info@ascontecnologic.com)


### PREFACE

 This manual contains the information necessary for the product to be installed correctly and also instructions for its maintenance and use; we therefore recommend that the utmost attention is paid to the following instructions and to save it.

This document is the exclusive property of Ascon Tecnologic S.r.l. which forbids any reproduction and divulgation, even partially, of the document, unless expressly authorized.

Ascon Tecnologic S.r.l. reserves the right to make any formal or functional changes at any moment and without any notice.

Ascon Tecnologic S.r.l. and its legal representatives do not assume any responsibility for any damage to people, things or animals deriving from violation, wrong or improper use or in any case not in compliance with the instrument features.

 Whenever a failure or a malfunction of the device may cause dangerous situations for persons, thing or animals, please remember that the plant has to be equipped with additional devices which will guarantee safety.

## 1. INSTRUMENT DESCRIPTION


### 1.1 General description

The probes of the **TRH200** series are devices with  $4 \div 20$  mA current output for monitoring relative humidity characterized by a very low energy consumption.

The **TRH200** uses a high-precision sensor and its conversion / retransmission devices are of quality to ensure high reliability and excellent long-term stability.


## 2. USAGE WARNINGS

### 2.1 Admitted usage

 The instrument has been projected and manufactured as a measuring and control device to be used according to EN60730-1 at altitudes operation below 2000 m.

Using the instrument for applications not expressly permitted by the above mentioned rule must adopt all the necessary protective measures.

The instrument **must not be used** in dangerous environments (flammable or explosive) without adequate protections.

 The installer must ensure that the EMC rules are respected, also after the instrument installation, if necessary using proper filters.

## 3. INSTALLATION WARNINGS

### 3.1 Mounting requirements


Select a mounting location having the following characteristics:

- It should be easily accessible;
- It must not be subjected to vibrations or impacts;
- Must be free from corrosive gases;
- Must be free from water or other fluids (condensation).

### 3.2 Installation position

Wall fixing is done by clips. Particular attention must be paid to the sensor positioning, it must be kept away from heat sources that can influence the humidity measurement.

It is a good idea to mount the probe with the sensor facing downwards (output cable upwards) and **NEVER** with the sensor facing upwards and also horizontally to avoid possible measurement errors due to self-heating.

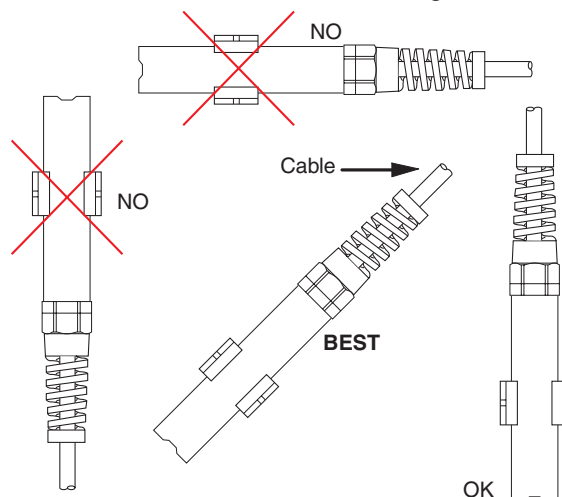

Any error in humidity measurement may be due to the settling time of the probe, in this case it will be necessary to wait for the time necessary to achieve a stable measurement.


Steam jets, water sprays, drafts, direct sun exposure, condensation on the sensor or mounting on a wall made cold by the outside temperature can also cause important measurement errors; due to these conditions, during the installation, the probe must be protected from any possible external influence.

3.3 Electrical Connections

General notes on electrical connections

- The probe cables must be kept separated from high power voltage wiring.

3.3.1 Electrical wiring

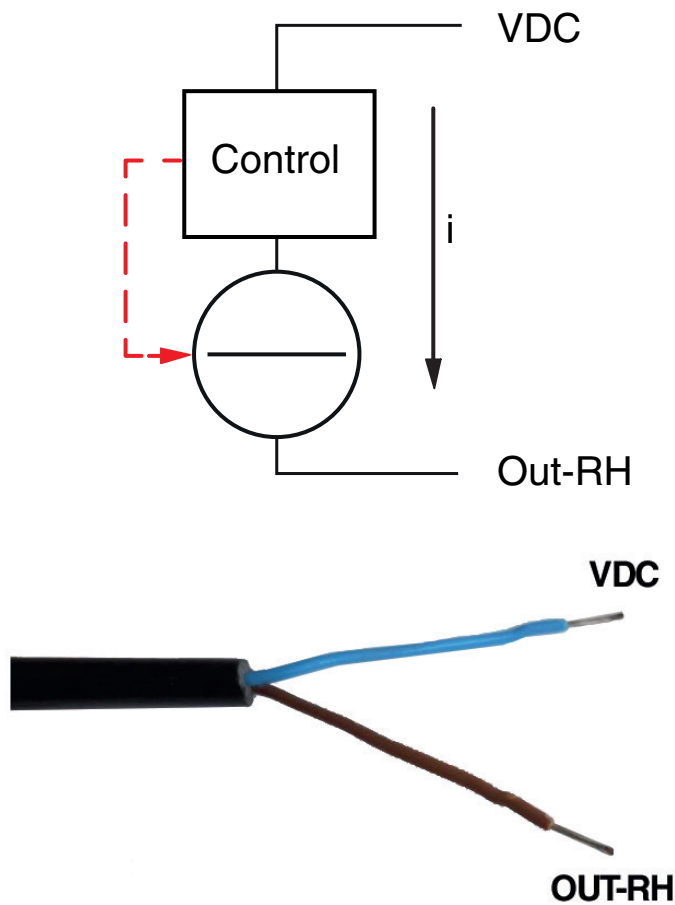

Power supply voltage: 9 ÷ 30 VDC;  
Current consumption: 20 mA;  
Reverse polarity protection: Diode;  
Cable length: 2 meters.

4. PROBLEMS AND MAINTENANCE

4.1 Cleaning

We recommend to clean the instrument with a slightly wet cloth using water and not abrasive cleaners or solvents only. Should it be necessary to remove the sensor, avoid to mechanical stress it and in particular avoid touching the humidity sensor.

4.2 Disposal



The appliance (or the product) must be disposed of separately in compliance with the local standards in force on waste disposal.

5. WARRANTY AND REPAIRS

The instrument is under warranty against manufacturing flaws or faulty material, that are found within 18 months from delivery date. The warranty is limited to repairs or to the replacement of the instrument.

The eventual opening of the housing, the violation of the instrument or the improper use and installation of the product will bring about the immediate withdrawal of the warranty effects. In the event of a faulty instrument, either within the period of warranty, or further to its expiry, please contact our sales department to obtain authorisation for sending the instrument to our company.

The faulty product must be shipped to Ascon Tecnologic with a detailed description of the faults found, without any fees or charge for Ascon Tecnologic, except in the event of alternative agreements.


6. TECHNICAL DATA

6.1 Sensor characteristics

Sensor type: CMOS-C.

6.1.1 Relative humidity

Parameter	Condition	Min.	Typical	Max.	Units
Resolution	12bit		0.04		%RH
	8 bit		0.7		%RH
Accuracy/ Tolerance	Typical		±3.0		%RH
	Max.		See figure		%RH
Repeatability			±0.1		%RH
Hysteresis			±1		%RH
Non-linearity			<0.1		%RH
Response time	τ63%		8		s
Operative range	Extended	0		100	%RH
Long-term drift	Normal		<0.5		%RH/year

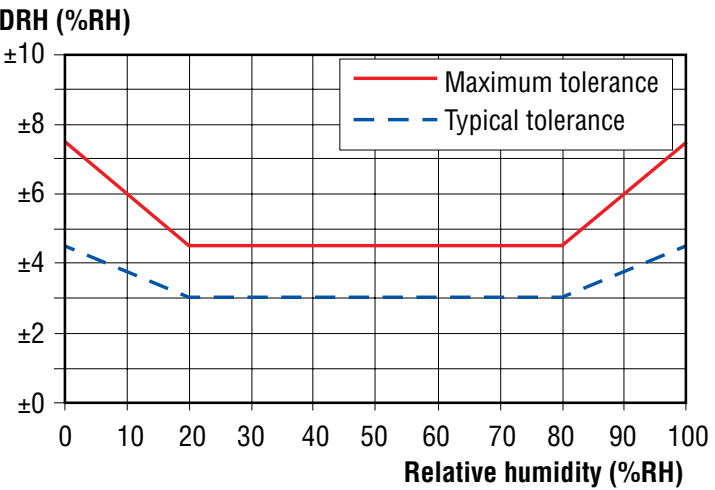

## 6.2 Filter characteristics

### 6.2.1 Technical specifications

Parameter	Value
Operative range	-40 ÷ +125
Protection degree (1)	IP67
RoHS	Compliant
Body material	Polybutylene terephthalate (PBT)
Body colour	Black
UL94 (body material only)	UL-94 V-0 (0.73 mm)
Filter material	PTFE with polyester scrim
Filter thickness	0.13 mm
Filter colour	Black
Filter pore size	1.5 µm
Filtration efficiency (2)	99.99%
Oleophobic Range (filter)(3)	8
Mullen Hydrostatic	>100 mbar (>1 m water)

- Notes:**
1. IP67: dust tight, protected against harmful water immersion up to 1 m water column (<http://en.wikipedia.org/wiki/IP67>);
  2. 0.1 µm particles at 0.05 m/s air flow;
  3. Repellence of oil and hydrocarbons according to AATC 118.1992 standard. Rating goes from 0 ÷ 8 while 8 is the most repellent.

## 6.3 Functional features

**Protection degree:** IP54 (protected against dust and water splashes from all directions);

**Installation method:** With clip;

**Electrical connections:** With 2 m wire;

**Dimensions (mm):** L = 100 mm + spiral, Ø16 mm;

**Ambient temperature:** -30 ÷ +70°C;

**Ambient humidity:** 0 ÷ 100% RH;

**Sensor type:** CMOS;

**Humidity measuring range:** 0 ÷ 100% RH;

**Output current:** 4 (0%) ÷ 20mA (100%);

**Internal dissipative element;**

**Sensor:** Interchangeable;

**Refresh:** 5 s;

**Response time at constant conditions (63%) at 23°C:** 30 s;

**Recovery time from saturation:** 90 s;

**Storage temperature:** -30 ÷ +80°C;

**Max. load:** 250 Ω;

**Sensor output signal:** 4 ÷ 20mA.

The output current is normally passed through the input resistance of the reading instrument and transformed into a voltage that can be read by the instrument.

In order to minimize self-heating, this model of probe uses the “switching mode” technique for controlling the output current.

