




# Y39C

## Modbus Communication protocol for Y39C

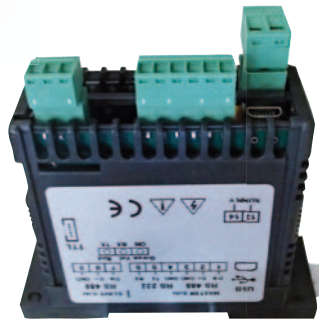

Vr. 03 (ENG) - 19/09 - cod.: ISTR-PY39CENG03

**Ascon Tecnologic S.r.l.**

Viale Indipendenza 56, 27029 Vigevano (PV) - ITALY

Tel.: +39 0381 69871 - Fax: +39 0381 698730

Sito: <http://www.ascontecnologic.com>

e-mail: [info@ascontecnologic.com](mailto:info@ascontecnologic.com)

### PREFACE

**!** The purpose of this document is to describe the communication capabilities of Y39C instruments which use the Modbus protocol and is dedicated to technicians, system integrators and software designers.

This document is exclusive property of Ascon Tecnologic which forbids any reproduction and divulgation, even in part, of the document, unless expressly authorized.

ASCONECNOLOGIC reserves the right to make any formal or functional changes at any moment and without any notice.

**!** Ascon Tecnologic and its legal representatives do not assume any responsibility for any damage to people, things or animals deriving from violation, wrong or improper use or in any case not in compliance with the instrument's features.

**!** Whenever a failure or a malfunction of the device may cause dangerous situations for persons, things or animals, please remember that the plant has to be equipped with additional devices which will guarantee safety.


### Index

<b>1</b>	<b>Connection</b> .....	<b>1</b>
1.1	Interface.....	1
1.2	RS485 LINE.....	1
<b>2</b>	<b>Modbus protocol</b> .....	<b>2</b>
2.1	Function 3 - Reading of n words.....	2
2.2	Function 6 - Writing a word.....	2
2.3	The Exception Reply .....	2
2.4	Cyclic Redundancy Ceck (CRC).....	3
2.5	Data exchange.....	3
2.6	Performance .....	3
<b>3</b>	<b>Memory area</b> .....	<b>4</b>
3.1	Variables Memory Area .....	4
3.2	Command memory area.....	5
3.3	Configuration and functional parameters area.....	6

## 1 CONNECTION


### 1.1 Interface

Y39C instruments are equipped with a **TTL communications port** through a 5-pole connector on the side of the instrument. Through the **TTL/RS485 interface** offered by the **ARS1** or **A30** devices and the appropriate cables (CATTL I for ARS1 and CATTL D for A30) it is possible to connect the instruments to an **RS485 type serial communications network**. To the network are normally linked other instruments (like controllers or PLC) and a personal computer used as system supervisor. The ARS1 device is powered directly by the instrument while the A30 device must be powered separately.

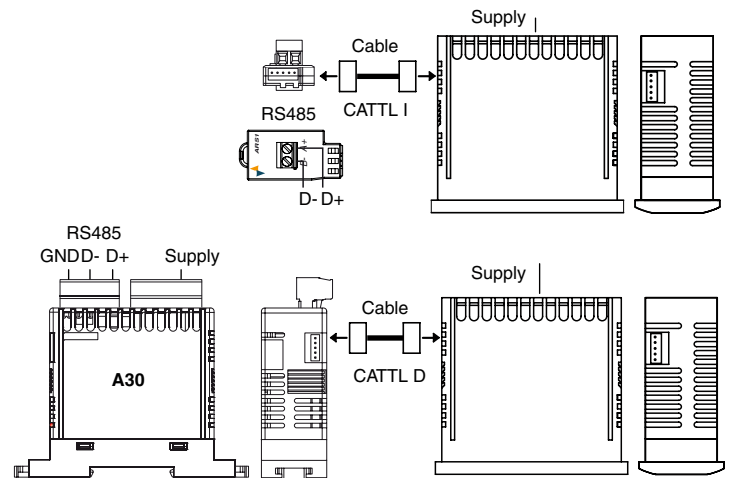


### 1.2 RS485 LINE

The converters are equipped with two terminals (**D+** and **D-**) which must be connected to all the homonymous terminals of the network. A telephone-type twisted pair is therefore sufficient for wiring the line.

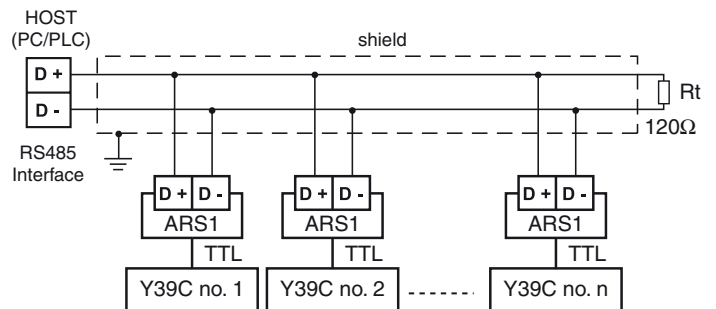

However, in particular when the network is very long or noisy and in the presence of potential differences between the various GND terminals, it is advisable to use a braided and

shielded 3-pole cable connected as shown in the figure.

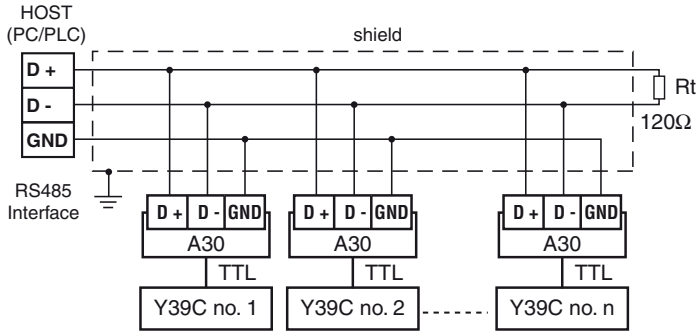

As illustrated, the line shield must be connected to ground at only one side.

This type of interface allows to connect up to 32 instruments on the same line. The total length of the line can reach a maximum of 1000 m. To maintain the line in resting conditions, the use of a 120 Ω termination resistance (RT) is required at the end of the line.

Once the network has been mounted it is necessary to program, using the *LR5* parameter, the address of each instrument on the network. Each instrument must have its own unique number from 1 to 255. In order to avoid communication conflicts, turn ON and program 1 instrument at a time. The baud rate of the serial port is fixed at 9600 baud.

## 2 MODBUS PROTOCOL

The protocol adopted these controllers is a sub-group of the widely used MODBUS RTU protocol. This choice guarantees easiness of connections to many PLCs and to all the commercial supervision programs.

The functions of the MODBUS RTU protocol used the controllers are:

- **Function 3:** Reading of *n* words;
- **Function 6:** Writing of a word.

These functions allow the supervision programs to read and change any data from the instrument. The communication is based on messages sent by the master station to a slave station (each controller) and vice versa. The slave station that recognises its own address in the message, analyses the content and, if it finds it to be semantically and formally correct, it then creates a reply message directed back to the master.

The communication process involves five types of message:

From master to slave	From slave to master
Function 3: request for reading of <i>n</i> words	Function 3: reply containing <i>n</i> words read
Function 6: request for writing of <i>a</i> word	Function 6: confirmation of writing of one word
	Exceptional reply (in reply to both functions in the event of an irregularity)

Each message contains four fields:

- **Slave address:** All values between 1 and 255 are valid;
- **Function code:** This field contains the number 3 or 6 depending on the required function;
- **Information field:** This field contains the addresses or the value of the words, as requested by the function in use;
- **Control word:** This field contains a cyclic redundancy check (CRC) calculated according to the rules provided for the CRC16.

The characteristics of the asynchronous communication are:

- 8 bit;
- No parity;
- One stop bit.

### 2.1 Function 3 - Reading of *n* words

The number of words that are to be read must be less or equal to four.

The request has the following structure:

slave #	3	1 <sup>st</sup> word Address		Number of words		CRC	
		MSB	LSB	MSB	LSB	LSB	MSB
byte 0	byte 1	byte 2	byte 3	byte 4	byte 6	byte 6	byte 7

A normal reply (unlike an exception in case of errors) has the following structure:

slave #	3	NB # bytes read	1 <sup>st</sup> word value		Later words	CRC	
			MSB	LSB		LSB	MSB
byte 0	byte 1	byte 2	byte 3	byte 4	byte 6	byte NB +2	byte NB +3

### 2.2 Function 6 - Writing a word

The write request has the following structure:

slave #	6	1 <sup>st</sup> word Address		Value to be written		CRC	
		MSB	LSB	MSB	LSB	LSB	MSB
byte 0	byte 1	byte 2	byte 3	byte 4	byte 6	byte 6	byte 7

The normal reply (unlike the exception reply) is purely an echo of the request message:

slave #	6	Address of 1 <sup>st</sup> word		Value to be written		CRC	
		MSB	LSB	MSB	LSB	LSB	MSB
byte 0	byte 1	byte 2	byte 3	byte 4	byte 6	byte 6	byte 7

### 2.3 The Exception Reply

These instruments provide an exception reply after having received a formally correct request that cannot be satisfied. The exception reply contains a code that indicates the cause of lack of the regular reply.

The reply structure is as:

slave #	Function code with MSB at 1	Exception code	CRC	
			LSB	MSB
byte 0	byte 1	byte 2	byte 3	byte 4

The controllers of this serie adopt a sub-group of exception codes of the MODBUS RTU

Unknown function code	1
Invalid memory address	2
Invalid value in data field	3
Data not ready	6

## 2.4 Cyclic Redundancy Ceck (CRC)


CRC is a check word that permits to verify the integrity of a message. Each message, sent or received, contains the CRC word as the last two characters of the message.

After receiving a request, the controller checks the validity of the message received, comparing the CRC contained in the message with the one calculated during reception.

While in transmission, the controller calculates the CRC and places the two characters at the end of the message.

The calculation of the CRC is carried out on each character of the message except for the last two.

As these instruments are compatible with the MODBUS RTU (JBUS) protocol, they use the same algorithm for calculating the CRC. The CRC algorithm is sketched in following diagram:

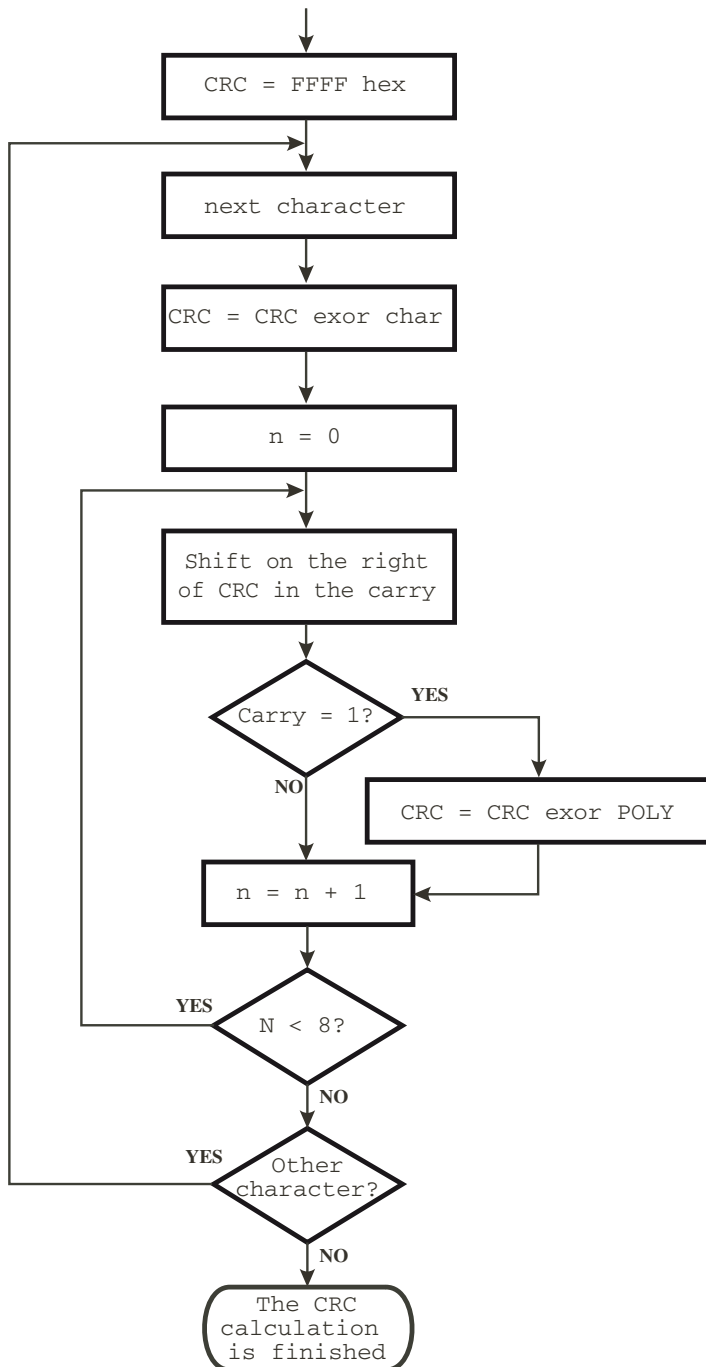

## 2.5 Data exchange

All the data exchanged are made up of 16 bit words.

There are two types of data: numerical (N) and symbolic (S) (or non numerical).

The numerical data represent the value of phisical dimension (**e.g.**: the measured variable, etc.).

The symbolic data represent a particular value within a range of choices (**e.g.** the temperature engineering unit can be "°C" or "°F").

Both types are encoded with integer numbers: integer numbers with a sign are adopted for numerical data (N) and integer numbers without a sign for symbolic data(S).

Numerical data must be associated with the appropriate number of decimal figures, so that it represents a size with the same engineering unit adopted in controller.

Numerical data are represented in fixed point according to the number of decimal digits shown in the tables of the chapter "Memory Area".

## 2.6 Performance

After receiving a valid request, the instrument prepares the reply and sends it to the master station, according to the modes specified below:

- A time equal to three characters is guaranteed before the reply to allow the line switching;
  - The answer is ready to be transmitted within a time that is less than 20 ms, with the exception made for function 3;
- A 20 ms of silence time on the line is necessary to recover all irregular conditions or error messages: this means that the time that runs between two consecutive characters in the same message must be less than 20 ms.
- It is possible to write one word at a time only.

### 3 MEMORY AREA

For the functions adopted, all the data that can be read and written appear as 16 bit words allocated in the instrument's memory.

The map of the memory has three areas:

- Variables,
- Parameters,
- Identification code of the instrument.

The following sections illustrate the characteristics of each of these areas.

#### 3.1 Variables Memory Area

In this area are stored the instrument main variables (inputs, control mode, outputs etc.) those that are frequently calculated and updated are grouped together. These are the data available:

Variable	Hex Addr.	Description	Data type	Dec. digits	Range
Pr1	200	Measurement input Pr1	N	1	-99.9 ÷ 999.0
Pr2	201	Measurement input Pr2	N	1	-99.9 ÷ 999.0
dP	202	Temperature decimal point position	S		1
Pr3	203	Measurement input Pr3	N	1	-99.9 ÷ 999.0
Lt	204	Pr1 min. measured Temperature (min. peak)	N	1	-99.9 ÷ 999.0
Ht	205	Pr1 max. measured Temperature (max. peak)	N	1	-99.9 ÷ 999.0
	206	Controller status	N		0 oFF 1 Control 2 Defrost
	207	Alarm condition (each alarm is associated to a bit of the word)	N		b0 Not used b1 1 = Overrange Pr1 (E1) b2 1 = Underrange Pr1 (-E1) b3 1 = Overrange Pr2 (E2) b4 1 = Underrange Pr2 (-E2) b5 1 = Overrange Pr3 (E3) b6 1 = Underrange Pr3 (-E3) b7 1 = Power On delay (od) b8 1 = High Alarm (Hi) b9 1 = Low Alarm (Lo) b10 1 = Door Open (oP) b11 1 = Input Alarm (AL)
	20D	Digital Input status	S		0 Open 1 Closed
	20E	Clock: Minutes and seconds	N		b0... b7 Seconds b8... b15 Minutes
	20F	Clock: Day and hours	N		b0... b7 Hours b8... b15 day
ot	210	Temperature control output	S		0 oFF 1 on
dF	211	Defrost Output	S		0 oFF 1 on
Fn	212	Evaporator fans output	S		0 oFF 1 on
Au	213	Auxiliary output	S		0 oFF 1 on
At	214	Acnowledgeable alarm output	S		0 oFF 1 on
AL	215	Not acnowledgeable alarm output	S		0 oFF 1 on
HE	216	Heat output	S		0 oFF 1 on
	217	Temperature control request (with no inhibitions)	S		0 oFF 1 on
	218	Fans ouput request (with no inhibitions)	S		0 oFF 1 on
	219	"Turbo" cycle request	S		0 oFF 1 on
	21A	Defrost request	S		0 oFF 1 on

Variable	Hex Addr.	Description	Data type	Dec. digits	Range
	21B	End defrost request	S		0 oFF 1 on
	21C	Auxiliary output activation request	S		0 oFF 1 on
	21D	Fans output inhibition due to the open door	S		0 oFF 1 on
	21E	Control output inhibition due to the open door	S		0 oFF 1 on
	21F	Open door	S		0 oFF 1 on
	220				
	221	Display lock during defrost	S		0 oFF 1 on
	222	Outputs inhibition for external alarm from digital input	S		0 oFF 1 on

Irregular conditions of the process variables are shown as special values of the measurement:

Irregular condition	Returned value	Instrument error
Short circuit on measurement input	-10000	-E
Open circuit on measurement input	10000	E
Overflow (A/D converter)	10001	
Variable not available	10003	----

### 3.2 Command memory area

The instrument controls include the commands that can be made from the instrument keyboard in order to perform particular actions or functions.

The data is write only.

Hex Addr.	Description	Data type	Range
280	"Turbo" cycle	S	1 = Start/Stop turbo cycle
281	Defrost start	S	1 = Start defrost
282	Defrost end	S	1 = End defrost
283	Auxiliary output activation	S	1 = Activate/Deactivate Auxiliary output
284	Stand-by	S	1 = Instrument Stand-by
285	ON	S	1 = Instrument ON
286	Minimum peak (Lt) reset	S	1 = Reset Lt
287	Maximum peak (Ht) reset	S	1 = Reset Ht
288	Alarms acknowledge	S	1 = Alarm Acknowledgement
289	Hour and Minute setting	N	b0 ÷ b7 = min b8 ÷ b15 = h
28A	Day setting	N	0 oF 1 Monday 2 Tuesday 3 Wednesday 4 Thursday 5 Friday 6 Saturday 7 Sunday

### 3.3 Configuration and functional parameters area

The operating and configuration parameters can be read and written through serial communication.

If one tries to read or write a parameter not available for a certain instrument configuration, an error message is displayed: **data not available. (6).**

After have written into the parameters zone, it is necessary to start the CHECKSUM calculation, writing any value at address **HEX 0500**.

Param.	Hex. Address	Description	Data type	# of Dec.	Range	Note
c.CL	2800	Current weekly day and time	N		b0 ÷ b5 Minutes (0 ÷ 59) b6 ÷ b7 Non used b8 ÷ 12 Hours (0 ÷ 23) b13 ÷ b15 Days [0 (clock disabled) ÷ 7]	
S.LS	2801	Minimum Setpoint	N	1	-99.9 ÷ HS	
S.HS	2802	Maximum Setpoint	N	1	LS ÷ 999.0	
SP	2803	Setpoint	N	1	S.LS ÷ S.HS	
SPE	2804	Economic (Eco) Setpoint	N	1	SP ÷ S.HS	
SPH	2805	Turbo Setpoint or Heating Setpoint in HC mode	N	1	S.LS ÷ SP	
i.uP	2806	Temperature Engineering unit and resolution (decimal point)	S		0 C0 °C resolution 1° 1 F0 °F resolution 1° 2 C1 °C resolution 0.1° 3 F1 °F resolution 0.1°	
i.SE	2807	Probes Type	S		0 nt NTC 1 Pt PTC 2 P1 PT1000	
i.Ft	2808	Measurement filter	N	1	0 oF 0.1 ÷ 20.0 s	
i.C1	2809	Pr1 Probe Calibration	N	1	-30.0 ÷ 30.0°C/°F	
i.C2	280A	Pr2 Probe Calibration	N	1	-30.0 ÷ 30.0°C/°F	
i.C3	280B	Pr3 Probe Calibration	N	1	-30.0 ÷ 30.0°C/°F	
i.CU	280C	Measure offset on the display	N	1	-30.0 ÷ 30.0°C/°F	
i.P2	280D	Pr2 input function	S		0 oF Not active 1 EP Evaporator probe	
i.P3	280E	Pr3 input function	S		0 oF Not active 1 EP Evaporator probe 2 Au Auxiliary probe 3 dG Digital input	
i.Fi	280F	Function and logic function of digital input	N	0	0 No function 1 Door open 2 Door open with fan stop 3 Door open with fan and compressor stop 4 External alarm 5 External alarm with deactivation of control outputs 6 Active Setpoint selection (SP/SPE) 7 Switch on/Switch off (Stand-by) 8 Turbo mode selection	
i.ti	2810	Digital input delay	N	2	0 oF 0.01 ÷ 99.59 (min.s)	
i.Et	2811	Delay to Eco mode with door closed	N	2	0 oF 0.01 ÷ 99.59 (h.min.)	
i.tt	2812	Time-out ECO mode	N	2	0 oF 0.01 ÷ 99.59 (h.min.)	
i.dS	2813	Variable normally shown on display	S		0 P1 Pr1 probe measurement 1 P2 Pr2 probe measurement 2 P3 Pr3 probe measurement 3 Ec Pr1 probe measurement (normal mode) Ec label (in Eco mode) 4 SP Active Setpoint 5 oF Display OFF	
r.d	2814	Differential (Hysteresis) in normal mode	N	1	0 oF 0.1 ÷ 30.0°C/°F	
r.Ed	2815	Differential (Hysteresis) in Eco mode	N	1	0 oF 0.1 ÷ 30.0°C/°F	
r.Hd	2816	Differential (Hysteresis) in Eco mode in "turbo" mode or Heating HC mode	N	1	0 oF 0.1 ÷ 30.0°C/°F	
r.t1	2817	Output (ot) activation time for probe (Pr1) error	N	2	0 oF 0.01 ÷ 99.59 (min.s)	

Param.	Hex. Address	Description	Data type	# of Dec.	Range	Note
r.t2	2818	Output (ot) deactivation time for probe (Pr1) error	N	2	0 oF 0.01 ÷ 99.59 (min.s)	
r.HC	2819	Output (ot) operating mode	S		0 H Heating 1 C Cooling 2 nr Neutral zone 3 HC Neutral zone with independent Setpoint 4 C3 Cooling with 3 automatic switch modes	
r.tC	281A	Turbo mode, time length	N	2	0 oF 0.01 ÷ 99.59 (h.min)	
d.tE	281B	End defrost temperature	N	1	- 99.9 ÷ 999.0 °C/°F	
d.tS	281C	Defrost enable temperature	N	1	- 99.9 ÷ 999.0 °C/°F	
d.tF	281D	Defrost start temperature	N	1	- 99.9 ÷ 999.0 °C/°F	
d.St	281E	Defrost start delay by $d_{tF}$ start temperature	N	2	0 oF 0.01 ÷ 99.59 (min.s)	
d.dL	281F	Defrost display Lock	S		0 oF Not active 1 on Active showing the last measure 2 Lb Active with label ( $d_{tF}$ during defrost and $P_{dF}$ during post-defrost)	
d.cd	2820	Delay start Defrost by continuous compressor running time	N	2	0 oF 0.01 ÷ 99.59 (h.min)	
d.dE	2821	Defrost cycle, max. time length	N	2	0 oF 0.01 ÷ 99.59 (min.s)	
d.dP	2822	Lenght pre-defrost for mixed defrost (hot gas/electric)	N	2	0 oF 0.01 ÷ 99.59 (min.s)	
d.Pd	2823	Lenght post-defrost for mixed defrost (hot gas/electric)	N	2	0 oF 0.01 ÷ 99.59 (min.s)	
d.td	2824	Compressor delay after defrost (drainage time)	N	2	0 oF 0.01 ÷ 99.59 (min.s)	
d.dt	2825	Defrost Type	S		0 EL Electrical heating/Compressor stop 1 In Hot gas/Reverse cycle 2 No Without compressor output conditioning 3 Et Electrical heating with evaporator temperature control	
d.dC	2826	Defrost starting mode	S		0 rt Real time intervals 1 ct Output ot ON time intervals 2 cS Defrost at all Output ot switching OFF (+ rt intervals) 3 cL Intervals set with real time clock	
d.PE	2827	End defrost temperature probe	S		0 oF End defrost only by time 1 EP EV probe 2 P1 Pr1 probe	
d.dn	2828	Number of daily defrosts	N	0	oF Function off 1 ÷ 8	
d.d1	2829	Time start defrost 1 (reference time first defrost of the day when $d_{dn}$ is different from oF)	N	1	oF -10 00.0 ÷ 23.5	
d.d2	282A	Time start defrost 2	N	2	oF -10 00.0 ÷ 23.5	
d.d3	282B	Time start defrost 3	N	2	oF -10 00.0 ÷ 23.5	
d.d4	282C	Time start defrost 4	N	2	oF -10 00.0 ÷ 23.5	
d.d5	282D	Time start defrost 5	N	2	oF -10 00.0 ÷ 23.5	
d.d6	282E	Time start defrost 6	N	2	oF -10 00.0 ÷ 23.5	
d.d7	282F	Time start defrost 7	N	2	oF -10 00.0 ÷ 23.5	
d.d8	2830	Time start defrost 8	N	2	oF -10 00.0 ÷ 23.5	
d.dH	2831	Number of daily defrosts on holidays	N	0	0 oF Function disabled 1 ÷ 4	
d.H1	2832	First defrost time on holidays	N	2	0 oF 0.0 ÷ 23.50	
d.H2	2833	Second defrost time on holidays	N	2	0 oF 0.0 ÷ 23.50	
d.H3	2834	Third defrost time on holidays	N	2	0 oF 0.0 ÷ 23.50	

Param.	Hex. Address	Description	Data type	# of Dec.	Range	Note
d.H4	2835	Fourth defrost time on holidays	N	2	0 oF 0.0 ÷ 23.50	
d.Hd	2836	Days considered as holidays	N	0	0 oF 1 Monday 2 Tuesday 3 Wednesday 4 Thursday 5 Friday 6 Saturday 7 Sunday 8 Saturday + Sunday	
d.di	2837	Defrosts interval	N	2	0 oF 0.01 ÷ 99.59 (h.min)	
d.Sd	2838	First defrost delay after power ON	N	2	0 oF (at Power ON) 0.01 ÷ 99.59 (h.min)	
d.dd	2839	Dynamic Defrost Percentage reduction	N	0	0 ÷ 100%	
d.Ei	283A	Defrost interval in case of evaporator probe error	N	2	0 oF 0.01 ÷ 99.59 (h.min)	
d.EE	283B	Defrost cycle duration in case of evaporator probe error	N	2	0 oF 0.01 ÷ 99.59 (min.s)	
F.tn	283C	Fan time activation with ot output (compressor) OFF	N	2	0 oF 0.01 ÷ 99.59 (min.s)	
F.tF	283D	Fan time deactivation with ot output (compressor) OFF	N	2	0 oF 0.01 ÷ 99.59 (min.s)	
F.FL	283E	High temperature fan deactivation	N	1	-99.9 ÷ 999.0°C/°F	
F.LF	283F	Low temperature fan deactivation	N	1	-99.9 ÷ 999.0°C/°F	
F.dF	2840	Differential fan control	N	1	0.0 ÷ 30.0°C/°F	
F.FE	2841	Fan during defrost	S		0 oF 1 on	
F.Fd	2842	Fan delay after defrost	N	2	0 oF 0.01 ÷ 99.59 (min.s)	
P.P1	2843	Control output ot delay when switched ON	N	2	0 oF 0.01 ÷ 99.59 (min.s)	
P.P2	2844	Control output ot delay when switched OFF	N	2	0 oF 0.01 ÷ 99.59 (min.s)	
P.P3	2845	Control output ot delay between 2 switch ON	N	2	0 oF 0.01 ÷ 99.59 (min.s)	
P.od	2846	Outputs delay at Power ON	N	2	0 oF 0.01 ÷ 99.59 (min.s)	
A.Ay	2847	Temperature alarm type	N	0	1 Absolute for Pr1 with label (Hi - Lo) 2 Relative for Pr1 with label (Hi - Lo) 3 Absolute for Au with label (Hi - Lo) 4 Relative for Au with label (Hi - Lo) 5 Absolute for Pr1 no label 6 Relative for Pr1 no label 7 Absolute for Au no label 8 Relative for Au no label	
A.HA	2848	High temperature Alarm threshold	N	1	-100 oF -99.9 ÷ 999°C/°F	
A.LA	2849	Low temperature Alarm threshold	N	1	-100 oF -99.9 ÷ 999°C/°F	
A.Ad	284A	Temperature Alarms Differential (Hysteresis)	N	1	0.0 ÷ 30.0°C/°F	
A.At	284B	Temperature Alarms delay	N	2	0 oF 0.01 ÷ 99.59 (min.s)	
A.tA	284C	Alarm memory	S		0 oF 1 on	
A.PA	284D	Temperature Alarms delay at Power ON	N	2	0 oF 0.01 ÷ 99.59 (h.min)	
A.dA	284E	Temperature Alarms delay after defrost and continuous cycle, and unlock display delay after defrost	N	2	0 oF 0.01 ÷ 99.59 (h.min)	
A.oA	284F	Open door alarm delay	N	2	0 oF 0.01 ÷ 99.59 (min.s)	



Param.	Hex. Address	Description	Data type	# of Dec.	Range	Note
<b>o.o1</b>	<b>2850</b>	Output Out1 function	S		0 oF No function 1 ot Temperature control (compressor) 2 dF Defrost 3 Fn Fan 4 Au Auxiliary	
<b>o.o2</b>	<b>2851</b>	Output Out2 function	S		5 At Acknowledgeable alarm (with NO output) 6 AL Not acknowledgeable alarm (with NO output) 7 An Stored alarm (with NO output) 8 -t Acknowledgeable alarm (with NC output) 9 -L Not acknowledgeable alarm (with NC output)	
<b>o.o3</b>	<b>2852</b>	Output Out3 function	S		10 -n Stored alarm (with NO output) 11 on ON when instrument switched ON 12 HE Heating control (with neutral zone) or Heat/Cool control	
<b>o.bu</b>	<b>2853</b>	Buzzer function mode	S		0 oF (function disabled) 1 Active for alarms only 2 Active for key pressed only 3 Active for alarms and key pressed	
<b>o.Fo</b>	<b>2854</b>	Auxiliary output function mode	N	0	0 oF (No Function) 1 Delayed Control output ( <b>ot</b> ) activation 2 Manual activation by key or digital input 3 Shop window light with economy mode (ON with <b>SP</b> and OFF with <b>SP2</b> ) 4 Internal light (OFF with door closed and ON with door opened)	
<b>o.tu</b>	<b>2855</b>	Time relative to auxiliary output	N	2	0 oF 0.01 ÷ 99.59 (min.s)	
<b>t.UF</b>	<b>2856</b>	Function mode <b>[U]</b> key	N	0	0 oF (No function) 1 Auxiliary output command 2 Continuous cycle command	
<b>t.Fb</b>	<b>2857</b>	Function mode key Down/Aux <b>[V]</b>	N	0	3 Active Setpoint selection (+ light OFF-eco mode) 4 Switch on/off (Stand-by)	
<b>t.Lo</b>	<b>2858</b>	Keyboard lock function delay	N	2	0 oF (function disabled) 0.01 ÷ 30.00 (min.s)	
<b>t.Ed</b>	<b>2859</b>	Setpoint visibility with <b>[P]</b> key fast procedure	N	0	0 oF None 1 SP 2 SPE 3 SP and SPE 4 Active SP 5 SP and SPH 6 SP, SPE and SPH	
<b>t.SA</b>	<b>285A</b>	Active mode (and Setpoint selected)	N	0	0 Normal with SP 1 Economic (Eco) with SPE	
<b>t.PP</b>	<b>285B</b>	Password to access parameter functions	N	0	0 oF (function disabled) 1 ÷ 999	
<b>t.AS</b>	<b>285C</b>	MODBUS Station address (for serial communication)	N	0	0 ÷ 255	





